



Shree Sandipani International School

Ref. No. SSIS/08/2024-25Date : 15/04/2024

ई - नगर पालिका, मध्य प्रदेश शासन
E-Nagar Palika, Government of Madhya Pradesh

Check Status And Download Fire Certificate

Please Enter Search Details

Please Enter Registration No. 61000142

Fire NOC Application Current Status Details

Application No. 61000142

Applicant Name SHREE SANDIPANI INTERNATIONAL SCHOOL

Current Status of the Application IN PROGRESS

Remarks(If Any)


ER. SHUBHAM JAIN
B.E. FIRE & SAFETY
LIC NO.07/BFB/2023
BHOPAL (M.P.)


ER. SHUBHAM JAIN
B.E. FIRE & SAFETY
LIC NO.07/BFB/2023
BHOPAL (M.P.)


2017 - 2018


Principal

Shree Sandipani International School
Dharmat Road, Chandrawati ganj, Dist. INDORE

 Dharmat Road, Chandrawati ganj
Teh. Sanwer Dist. Indore (M.P.) - 45351

 9993205269

 ssisc777@gmail.com

 WWW.shreesandipaniinternationalschool.com




PLAN FOR :
**SHREE SANDIPANI
 INTERNATIONAL
 SCHOOL.**


TITLE :
FIRE PLAN

DRAWN BY :
SANDEEP VERMA


ALL DIMENSIONS ARE IN METER

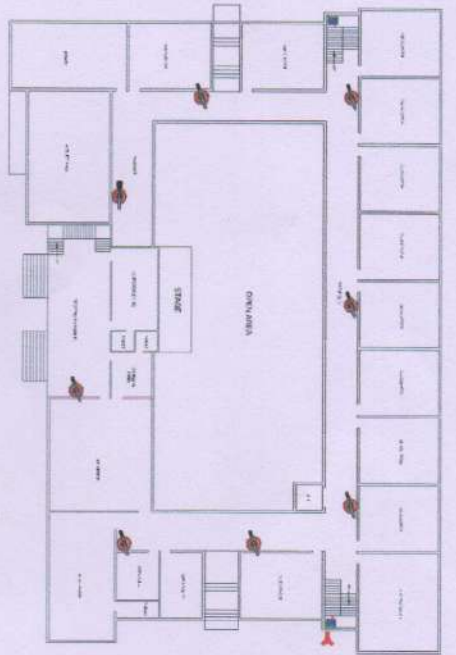


GROUND FLOOR

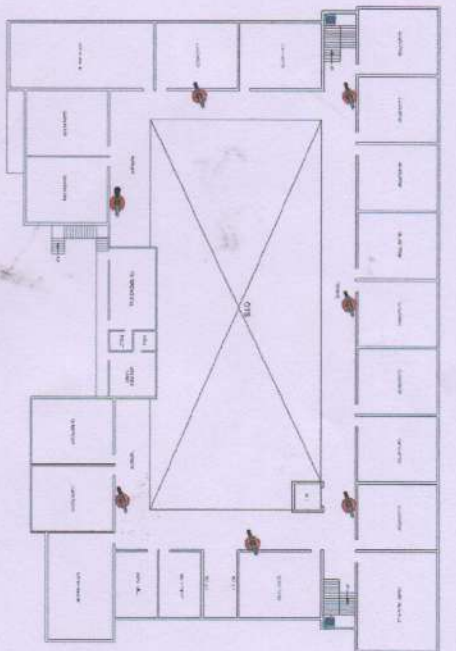


FIRST FLOOR

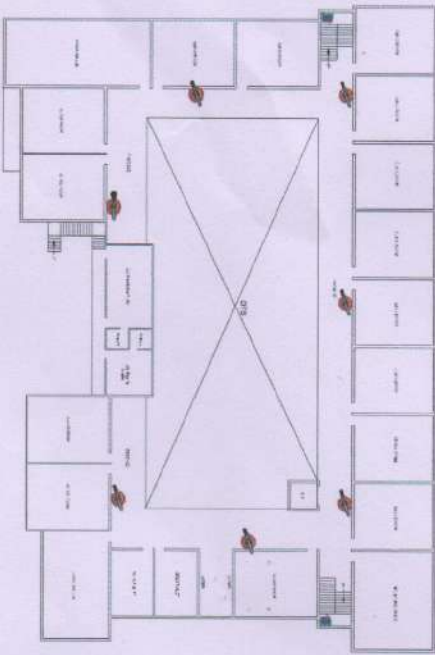

SECOND FLOOR

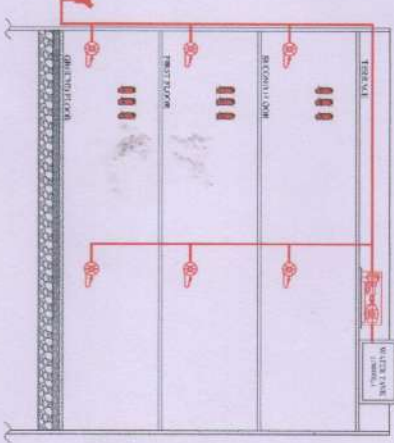

SECTION

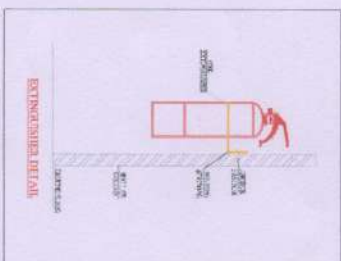

SIGNATURE OF OWNER

Er. Shree Sandipani International School
 Authorised Signatory

SIGNATURE OF FIRE ENGINEER

ER. SHUBHAM JAIN
 B.E. FIRE & SAFETY
 LIC NO. 07/BFB/2023

Principal
Shree Sandipani International School
 Dharmat Road, Chandragiri, Dist. Mysore

| SYMBOL | DESCRIPTION | QUANTITY |
|--------|----------------------------|----------|
| | HOSE REEL | 6 |
| | ABC TYPE FIRE EXTINGUISHER | 19 |
| | CO2 TYPE FIRE EXTINGUISHER | 3 |
| | HYDRANT PIPE | |
| | F.F. PUMP (450 LPM) | 1 |
| | TWO WAY VALVE | 1 |